




Cto.								Watts	Ampers	Calibre Conductor
C1	35							525	4.59	12
C2										
C3	15							225	1.96	14
C4		8						120	1.04	14
C5			13					2340	20.47	
C6				1				400	3.49	12
C7					2			800	6.99	12
C8						5		2000	17.49	12
C9		R	E	S	E	R	V	A		
C10		R	E	S	E	R	V	A		
C11		R	E	S	E	R	V	A		
Total	35	15	8	13	1	2	5	6410	56.03	

Int. Termomagnética	
POLOS	AMPERES
1	15
1	15
1	30
1	15
1	20
	125

SIMBOLOGÍA:

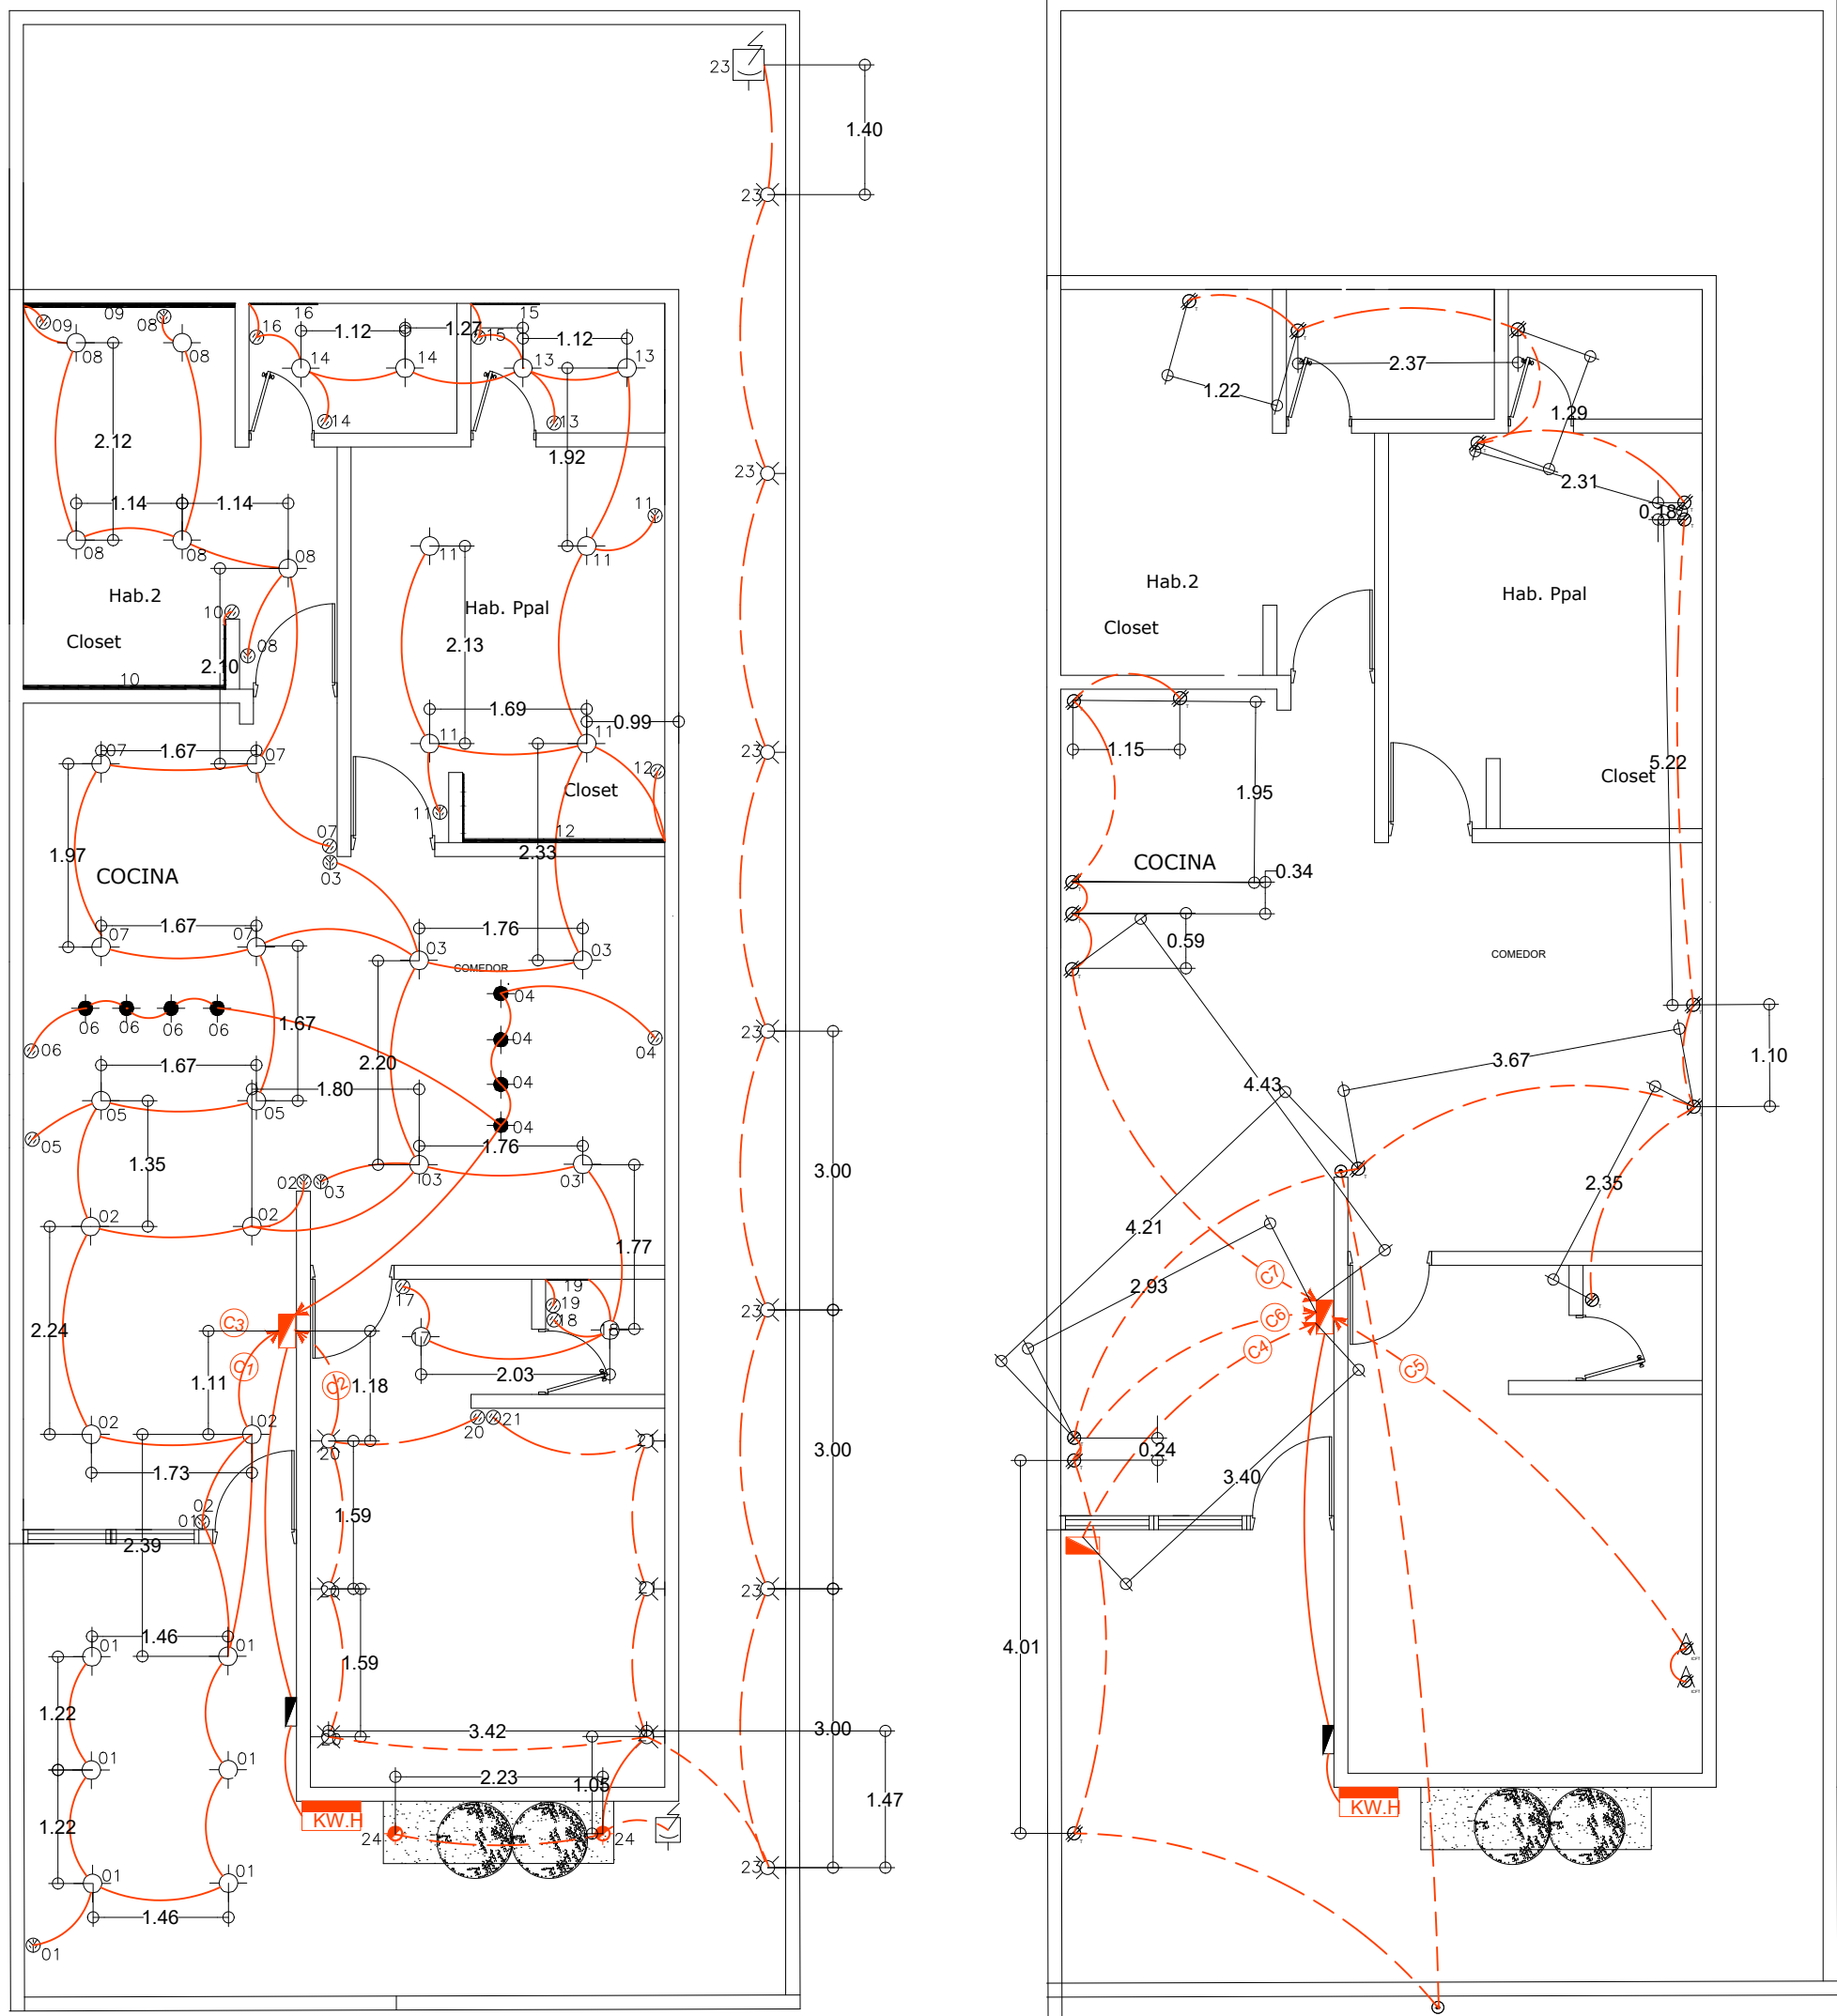









APAGADOR ESCALERA 10 a127 v

APAGADOR SENCILLO 10 a120 v

CONTACTO SENCILLO POLARIZADO 15 a120v

CONTACTO DUPLEX POLARIZADO 15 a120v

BOTON DE TIMBRE

CONTACTO DUPLEX POLARIZADO INTTEMPERIE 15 a120v.

SALIDA DE CENTRO

SALIDA ARBOTANTE CON BLOCK SOQUET 6 de UREA DE 10mm

SALIDA DE CENTRO COLGANTE

TABLERO DE DISTRIBUCION

CENTRO DE CARGA

CENTRO DE CARGA PARA BOMBA

MEDIDOR

LUZ LED

TUBERIA INST. ELECTRICA POR PISO

TUBO INST. ELECTRICA POR MURO o LOSA

D.R.O

PROYECTO:

OBRA NUEVA

LOCALIZACIÓN:

SUPERFICIE TOTAL DE CONSTRUCCIÓN:

PROYECTÓ:

CARLOS JESÚS ORDOÑEZ CASTRO

FECHA:

04/ JULIO / 2025

ESCALA:

1:100

COTAS:

METROS

PLANO:

ARQUITECTÓNICO

CLAVE:

A-001